Active Groundwater Withdrawal Permits That Could Be Serviced by Public Water Systems in South Hampton Roads

Groundwater Withdrawal Permits

Permitted Withdrawal *

- 0.01 - 1.28 MGD
- 1.29 - 2.88 MGD
- 2.89 - 6.67 MGD
- 6.68 - 20.61 MGD

System Use**

- Community Water System
- Industrial
- Other (Agriculture/Commercial/Irrigation)

*Permitted withdrawal given as million gallons/day (MGD)
** Selected systems are within 2 miles of public water system service areas

Public Purveyor Service Areas

- City of Chesapeake
- City of Norfolk
- City of Portsmouth
- City of Suffolk
- City of Virginia Beach
- Indian River Water Co. (Private)
- Future Public Service Areas
- Purchase Water from Public Systems
- Systems with Unrestricted Withdrawals (US Navy)
- Certificate of Groundwater Rights

Source: Virginia 2013 DEQ Groundwater Permit Database; HRPDC
Map created by HRPDC Staff, March 2014
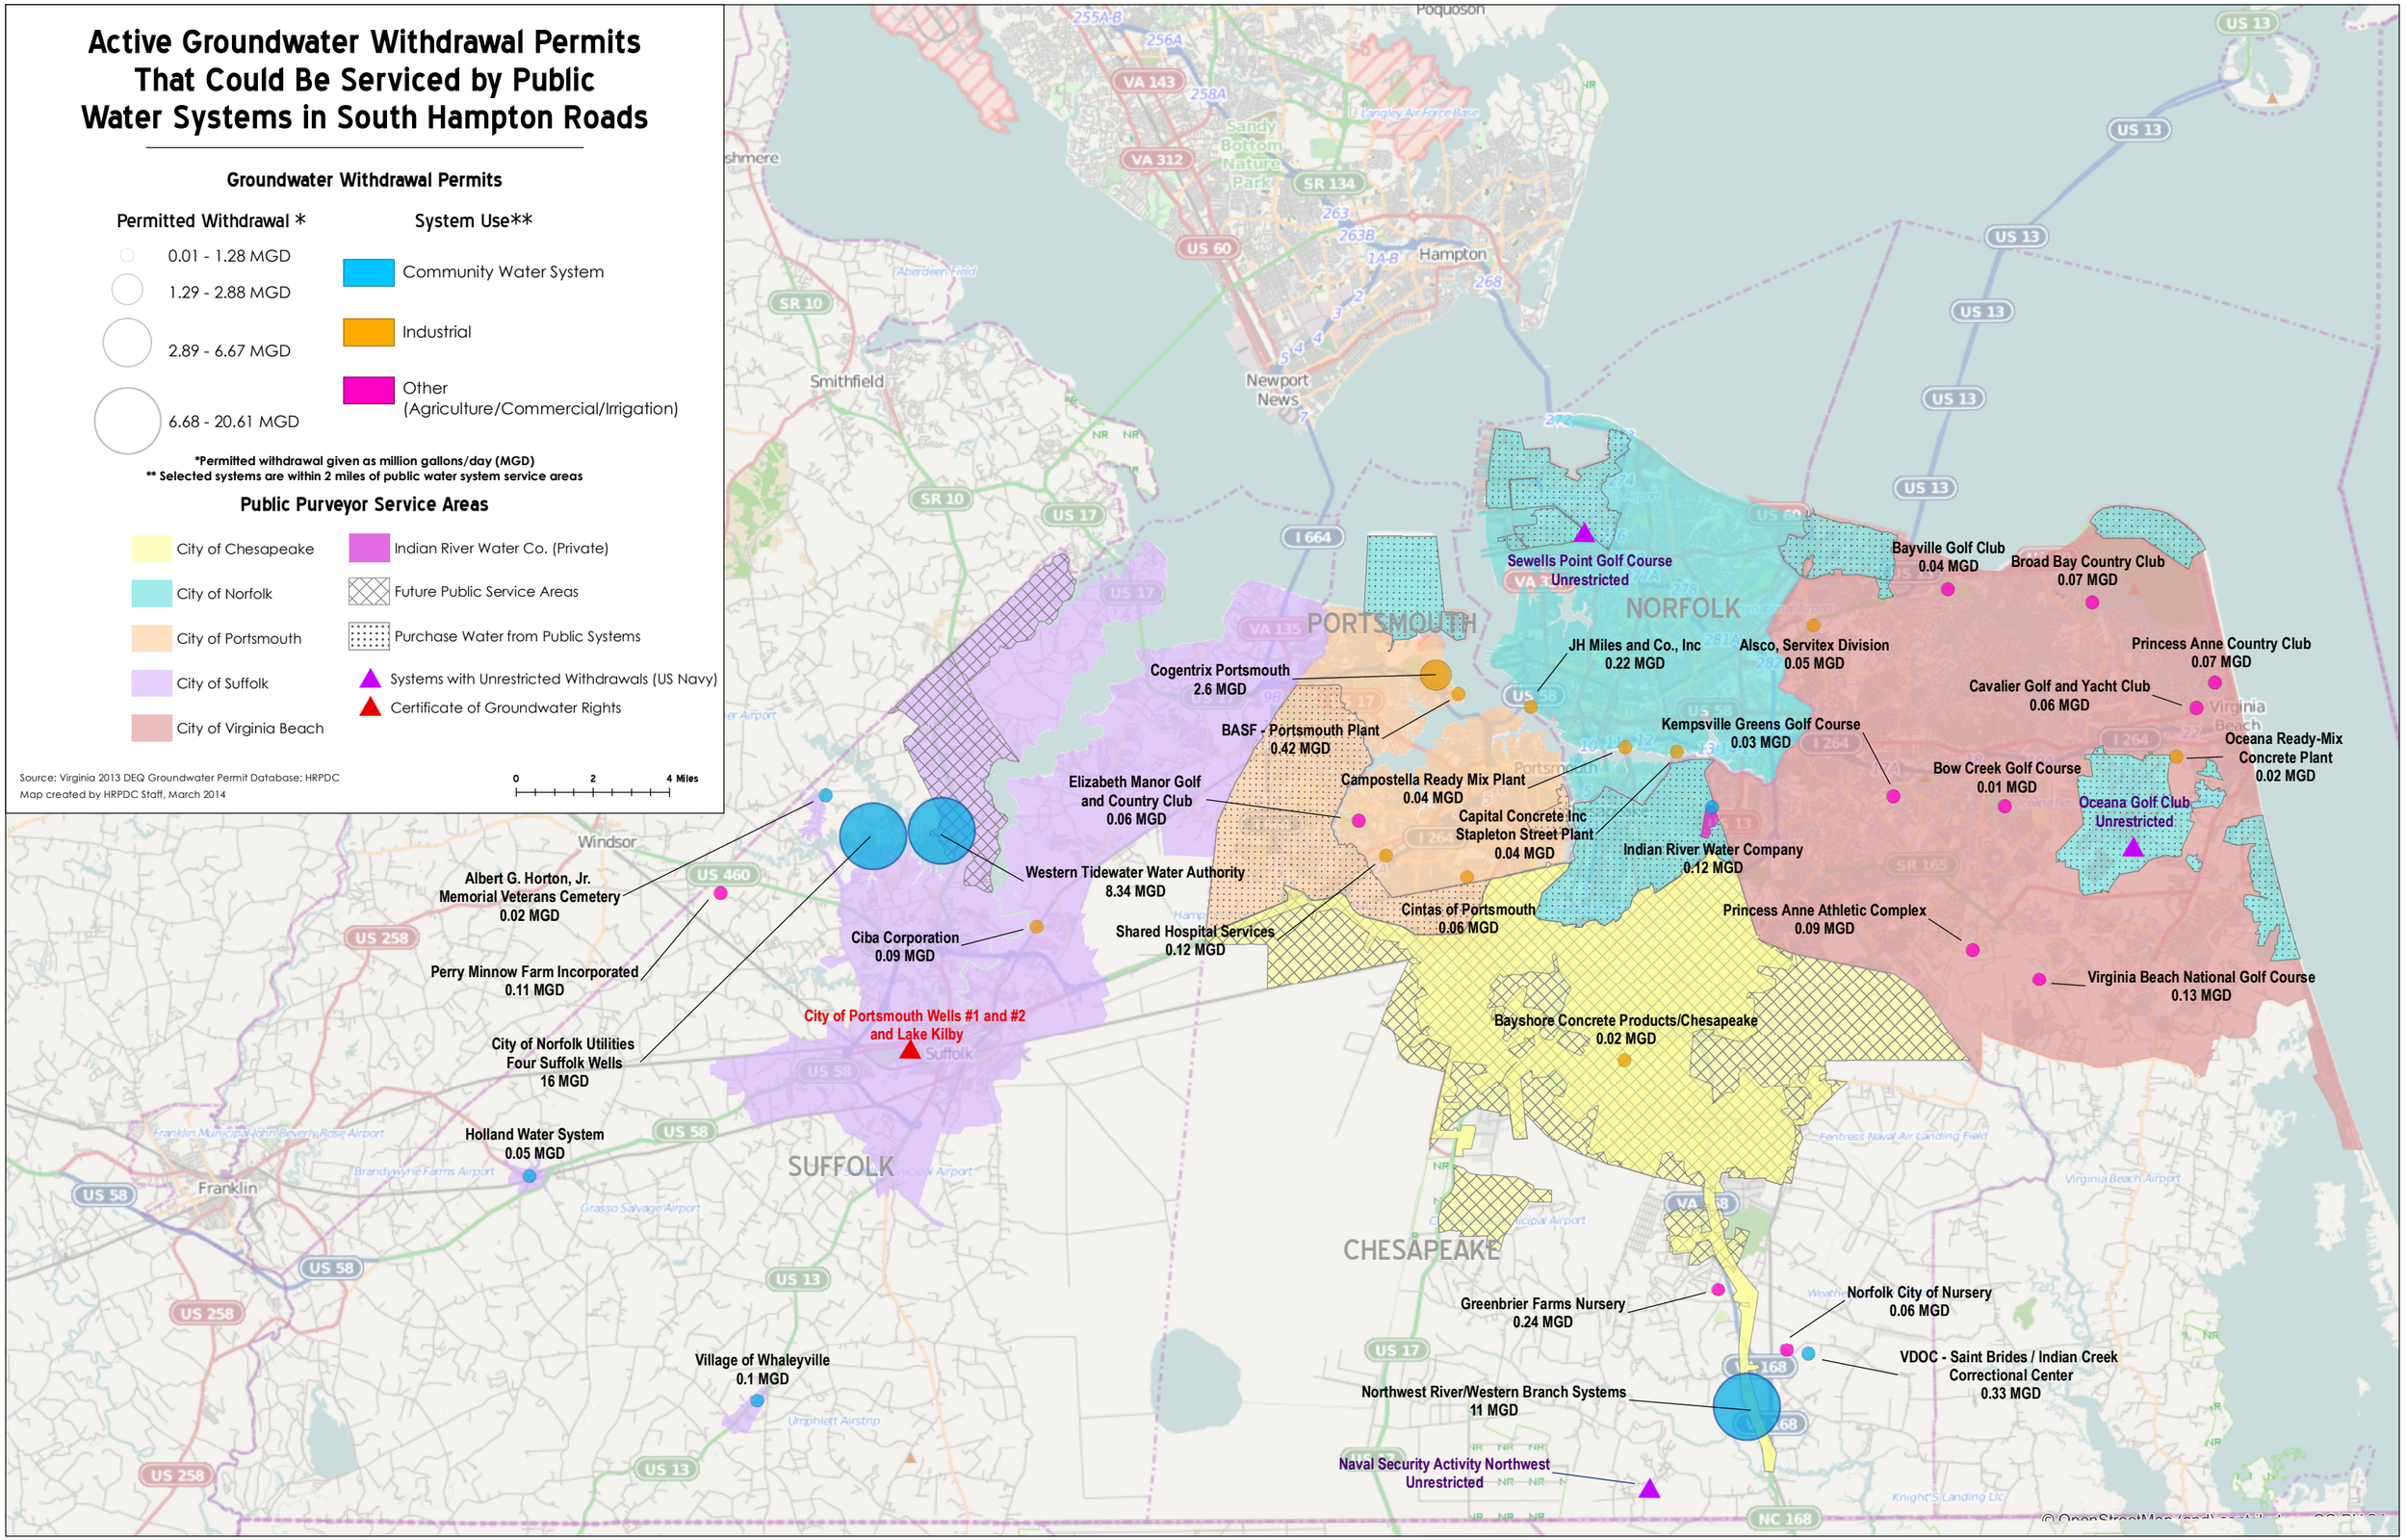
0 2 4 Miles