


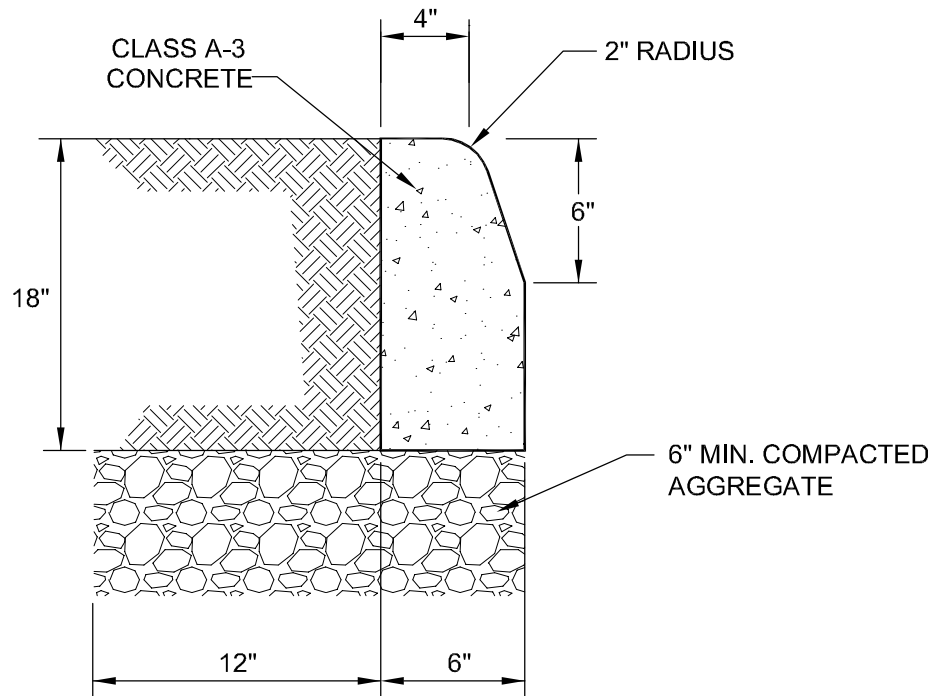

NOTES:

1. CRACK CONTROL JOINTS TO BE PROVIDED AT 10 FT. INTERVALS BY SAWING, SCORING, "LEAVE-IN" INSERTS, OR CUTTER PLATES TO 1-1/2 INCH DEPTH.
2. EXPANSION JOINTS TO BE INSTALLED PER SPECIFICATIONS SECTION 502.
3. AS SOON AS CONCRETE WILL NOT SLUMP, FACE FORMS ARE TO BE REMOVED, IRREGULARITIES REMOVED, A LIGHT BROOM FINISH GIVEN, AND LIQUID MEMBRANE SEAL OR OTHER APPROVED CURING MEDIUM APPLIED.
4. THE CONTRACTOR SHALL PREVENT THE TEMPERATURE AT THE SURFACE OF THE CONCRETE FROM FALLING BELOW 40°F DURING THE FIRST 72 HOURS IMMEDIATELY FOLLOWING CONCRETE PLACEMENT. PROTECTIVE MATERIAL SHALL BE LEFT IN PLACE FOR AN ADDITIONAL 48 HOURS IF FREEZING AIR TEMPERATURES ARE EXPECTED TO CONTINUE.

STANDARD MEDIAN CURB

NOT TO SCALE

REFERENCE 200,502	CATEGORY CONCRETE ITEMS	DATE 12/10	SHEET No. 1 OF 1	DETAIL No. CI_03
----------------------	----------------------------	---------------	---------------------	---------------------