


PLAN

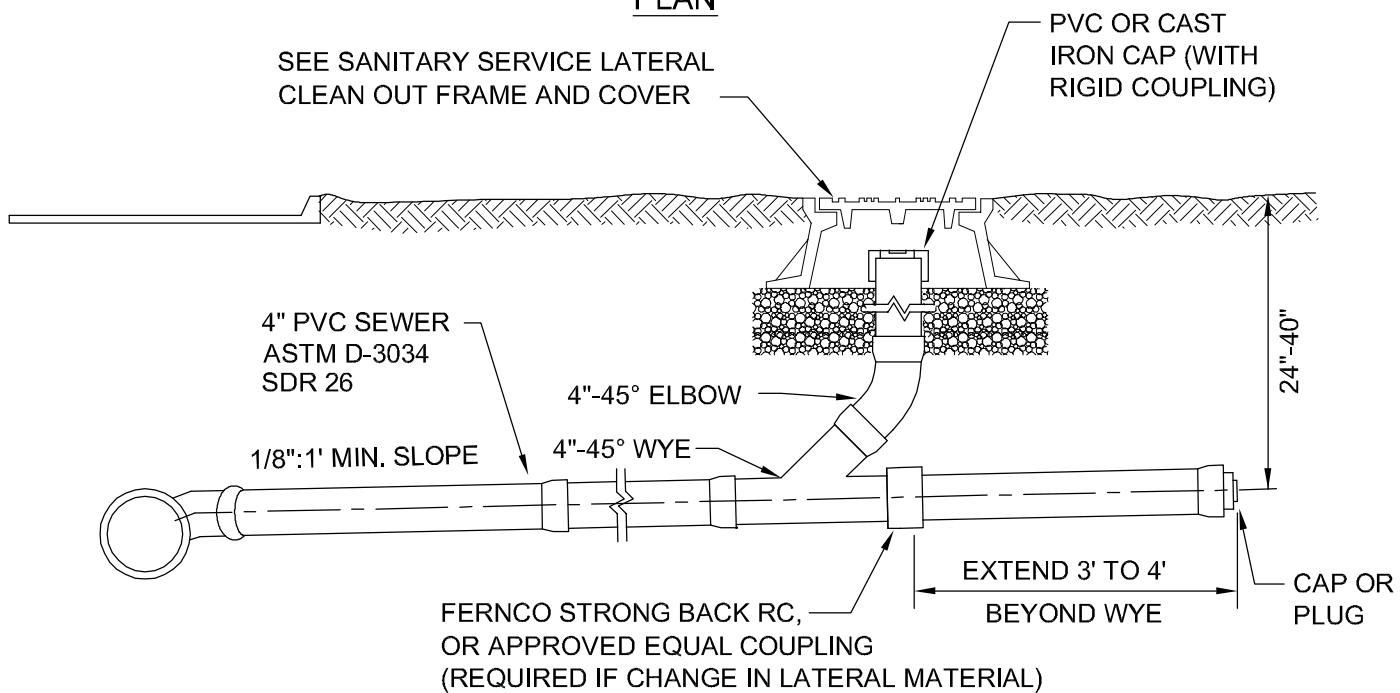

ELEVATION

NOTES:

1. LATERAL PIPE SHALL BE PVC, ASTM D-3034, SDR 26, UNLESS DUE TO SPECIAL CIRCUMSTANCES THE LOCALITY REQUIRES THE PIPE TO BE DUCTILE IRON.
2. SEE PLANS FOR LOCATION OF CLEAN OUT.

## SANITARY SEWER SERVICE CONNECTION

NOT TO SCALE

REFERENCE	CATEGORY	DATE	SHEET No.	DETAIL No.
200,802	SANITARY SYSTEMS	12/10	1 OF 1	SS_14