


NOTE:

MARK WITH A "W" FOR WATER DISTRIBUTION SYSTEMS OR "S" FOR SANITARY SYSTEMS. TOP & BOTTOM OF LETTER DESIGNATION TO BE IN LINE WITH NOTCHES.




REGIONAL CONSTRUCTION STANDARDS

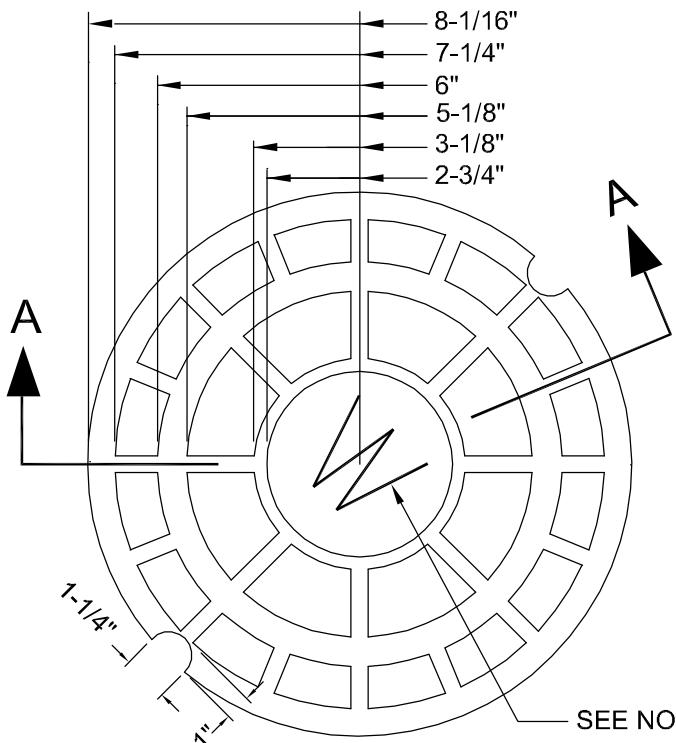


SEE NOTE, THIS SHEET

COVER: TOP

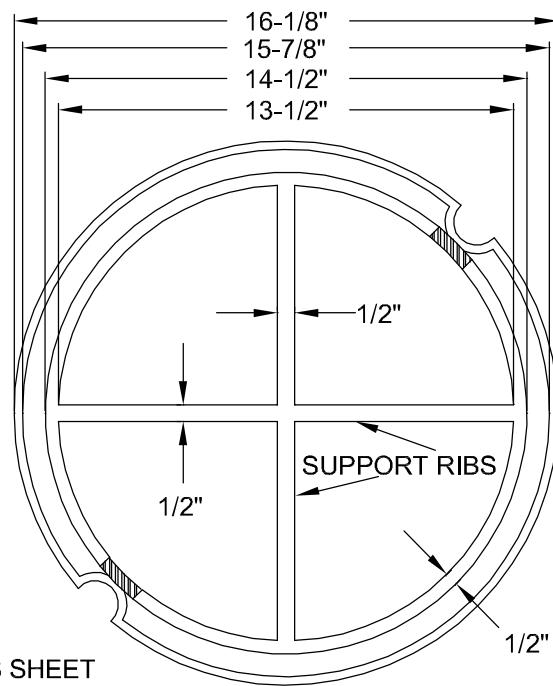

COVER: BOTTOM

BOTTOM SUPPORT RING TO BE
NOTCHED DIRECTLY UNDER PICK HOLE
ON BOTH SIDES. NOTCHES TO BE
CENTERED BETWEEN SUPPORT RIBS.

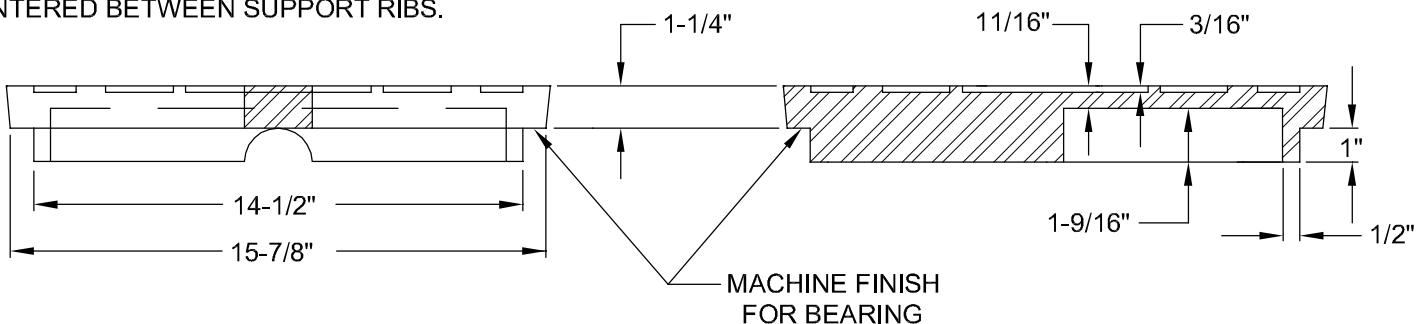

SIDE VIEW

SECTION A-A

SEE WS_01, SHEET 2 OF 2 FOR NOTES & FRAME DETAILS.

STANDARD VALVE BOX FRAME AND COVER

NOT TO SCALE

REFERENCE 200,801,803	CATEGORY WATER & SANITARY	DATE 12/10	SHEET No. 1 OF 2	DETAIL No. WS_01
--------------------------	------------------------------	---------------	---------------------	---------------------