



REGIONAL CONSTRUCTION STANDARDS

FIFTH EDITION

Publication Update #9


Full Committee Approved Proposed Revision #14
as Publication Update #9.

Replace Standard Detail WD_01

April 24, 2014

© Copyright 2008

**CDM
Smith**

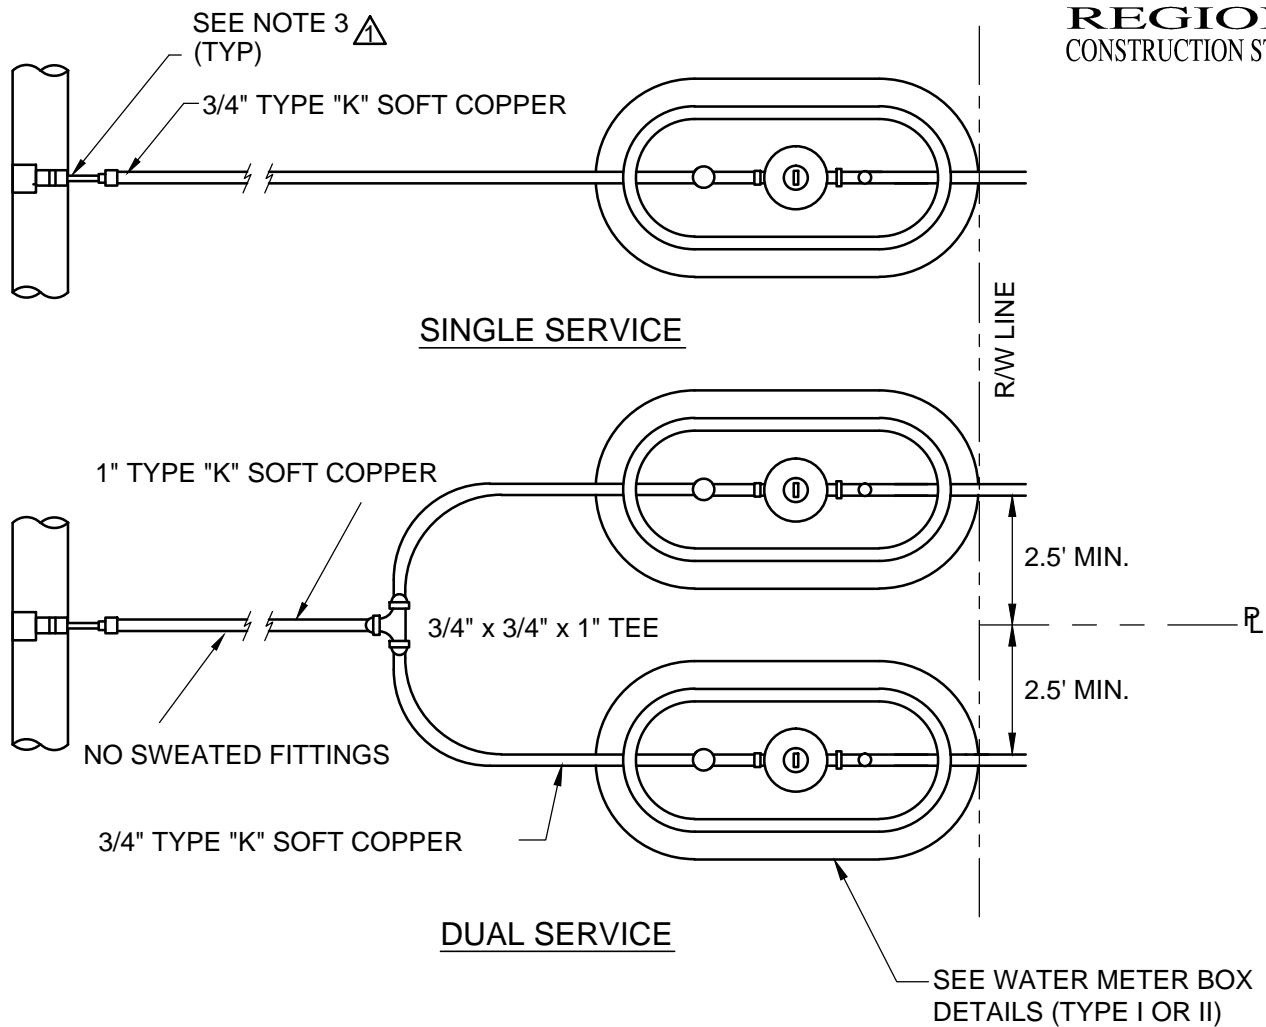

NOTES:

1. DUAL SERVICE REQUIRES PRIOR LOCALITY APPROVAL.
2. CONTRACTOR SHALL USE APPROVED BENDING TOOLS WHEN INSTALLING COPPER PIPE.
3. ALL DUCTILE IRON MAINS, SIX INCHES IN DIAMETER AND LARGER, MAY BE TAPPED WITHOUT SADDLES. WHERE PVC MAINS ARE PERMITTED BY LOCALITIES, THE CONNECTION TO A PVC MAIN MUST BE MADE WITH A TAPPING SADDLE. TAPPING SADDLES TO BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURERS SPECIFICATIONS. ALL SADDLES AND HARDWARE TO BE STAINLESS STEEL OR EPOXY COATED.
4. WHERE APPLICABLE, THE METER BOX IS TO BE LOCATED IN THE RIGHT-OF-WAY BETWEEN THE BACK OF CURB AND SIDEWALK.

SINGLE & DUAL SERVICE CONNECTIONS

NOT TO SCALE

△ REVISED 1/29/14

REFERENCE 200,801	CATEGORY WATER DISTRIBUTION	DATE 12/10	SHEET No. 1 OF 1	DETAIL No. WD_01
----------------------	--------------------------------	---------------	---------------------	---------------------