



## PLAN: FRAME

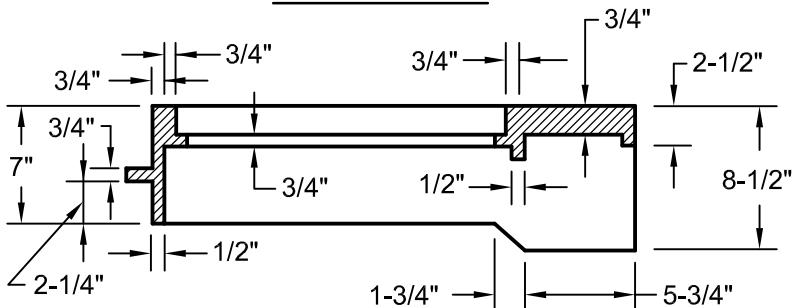

## SECTION A-A

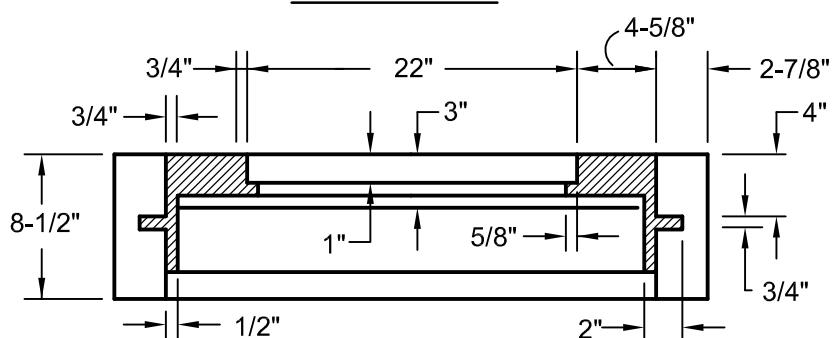

## SECTION B-B

# CURB INLET/CATCH BASIN FRAME AND COVER

NOT TO SCALE

1. FRAME & COVER TO BE SUPPLIED BY CAPITAL FOUNDRY OF VIRGINIA, INC., OR APPROVED EQUAL.
2. ALL GRAY IRON CASTINGS SHALL CONFORM TO LATEST EDITION OF ASTM A-48, CLASS 30 AND SHALL BE OF UNIFORM QUALITY.
3. ALL CASTING DIMENSIONS SHALL HAVE A TOLERANCE OF  $1/8" \pm$ .
4. ALL CASTINGS SHALL BE CLEANED BY SHOT BLASTING AND HAND CHIPPING UTILIZING STANDARD INDUSTRY PRACTICES PRIOR TO SHOP APPLICATION OF ASPHALTIC COATING BY DIPPING.

REFERENCE 200,302	CATEGORY DRAINAGE STRUCTURES	DATE 6/16	SHEET No. 1 OF 1	DETAIL No. DS_03
----------------------	---------------------------------	--------------	---------------------	---------------------