


- * TYPE I WATER METER BOX: 7.5"-22" AS APPROVED BY LOCALITY
- TYPE II WATER METER BOX: 10.25"-22" AS APPROVED BY LOCALITY

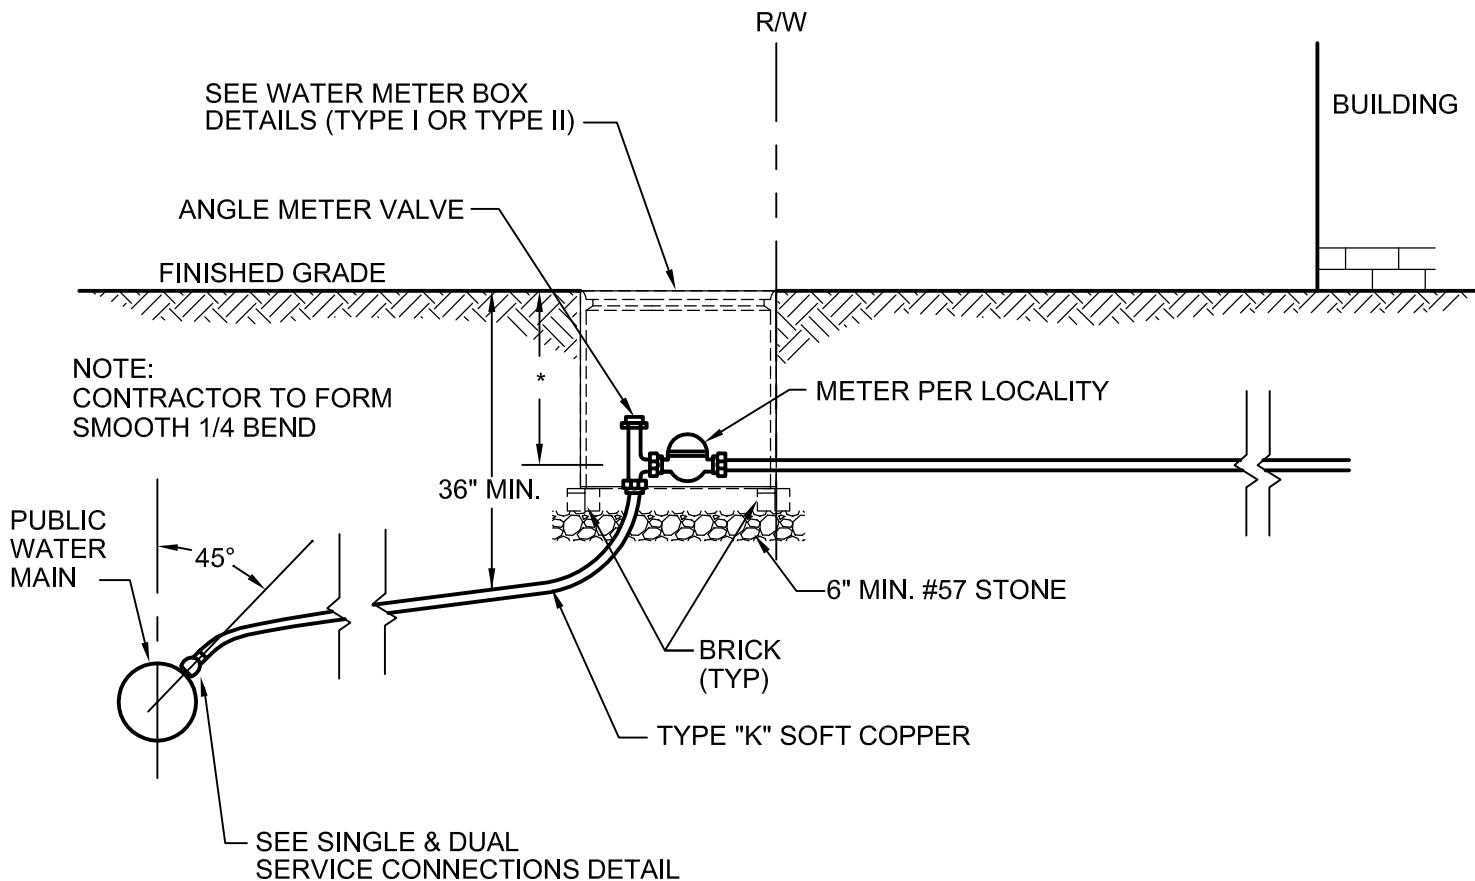

NOTES:

1. ALL DUCTILE IRON MAINS, SIX INCHES IN DIAMETER AND LARGER, MAY BE TAPPED WITHOUT SADDLES. WHERE PVC MAINS ARE PERMITTED BY LOCALITIES, THE CONNECTION TO A PVC MAIN MUST BE MADE WITH A TAPPING SADDLE. TAPPING SADDLES TO BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURERS SPECIFICATIONS. ALL TAPPING SADDLES TO BE STAINLESS STEEL OR EPOXY COATED.
2. METER SHALL BE 5/8" MINIMUM THRU 1" MAXIMUM.
3. INSTALL METER BOX BETWEEN THE CURB & GUTTER AND THE SIDEWALK. METER BOXES SHALL NOT BE INSTALLED IN DRIVEWAYS OR SIDEWALKS.
4. ALL BENDS IN TYPE K COPPER SHALL BE MADE USING AN APPROPRIATE PIPE BENDING TOOL. THERE SHALL BE NO CRIMPS IN THE PIPE LINE.

WATER SERVICE INSTALLATION DETAIL

NOT TO SCALE

REFERENCE	CATEGORY	DATE	SHEET No.	DETAIL No.
200,801	WATER DISTRIBUTION	6/16	1 OF 1	WD_02